

CLASSIFICATION OF REACTION TO FIRE

FIRES-CR-182-25-AUPE

Loadbearing wall composed of EcoCocon straw modules

This is an electronic version of the classification report, which is equivalent to the printed version. The electronic version is always issued, the printed version is issued only at the request of the sponsor. The document does not contain visual signatures of the responsible persons. The validity of the document is conditional upon a valid certified digital seal. The original file containing this document can be downloaded from the secure cloud FIRES, s.r.o., after getting the link from the sponsor. Any information listed in this document is the property of the sponsor and shall not be used or published without written permission. This file may only be modified by the editor i.e. Testing laboratory FIRES, s.r.o. Sponsor is allowed to publish this document in parts only with written permission of the editor.

CLASSIFICATION OF REACTION TO FIRE IN ACCORDANCE WITH EN 13501-1: 2018 with direct field of application

FIRES-CR-182-25-AUPE

Name of the product: Loadbearing wall composed of EcoCocon straw modules

Sponsor: EcoCocon UAB
Gedimino str. 30
70421 Kybartai
Lithuania

Prepared by: FIRES, s.r.o.
Notified Body No. 1396
Osloboditeľov 282
059 35 Batizovce
Slovak Republic

Task No.: PR-25-0160

Date of issue: 26. 09. 2025

Reports: 2
Copy No.: 2

Distribution list:

Copy No. 1 FIRES, s. r. o., Osloboditeľov 282, 059 35 Batizovce, Slovak Republic
Copy No. 2 EcoCocon UAB, Gedimino str. 30, 70421 Kybartai, Lithuania

This classification report may only be used or reproduced in its entirety.

This report includes accreditation mark SNAS with additional mark ILAC-MRA. SNAS is signatory of ILAC-MRA, Mutual recognition agreement (of accreditation), which is focused on promoting of international acceptance of accredited laboratory data and reducing technical barriers to trade, such as the retesting of products on markets of signatories. More information about ILAC-MRA is on www.ilac.org. Signatories of ILAC-MRA are e.g. SNAS (Slovakia), CAI (Czech Republic), PCA (Poland), DakKS (Germany) or BMWA (Austria). Up to date list of ILAC-MRA signatories is on <http://ilac.org/ilac-mra-and-signatories/>. FIRES, s.r.o., Batizovce is full member of EGOLF also, more information www.egolf.org.uk. Classification reports with direct field of application issued by FIRES, s.r.o. are valid in United Arab Emirates based on list of laboratories approved by United Arab Emirates Ministry of Interior Civil Defence (up-to-date list is available on: www.dcd.gov.ae/eng/) and are valid in Qatar based on list of laboratories approved by Ministry of Interior General Directorate Civil Defence of Qatar (up-to-date list is available on: <https://fires.sk/wp-content/themes/fires/img/files/QATAR.pdf>).



1. INTRODUCTION

This classification report defines the reaction to fire assigned to element Loadbearing wall composed of EcoCocon straw modules in accordance with the procedures given in EN 13501-1: 2018.

2. DETAILS OF CLASSIFIED PRODUCT

2.1 GENERAL

The element, Loadbearing wall composed of EcoCocon straw modules product name (as described by the sponsor), is defined as a load-bearing wall with fire separating function.

2.2 PRODUCT DESCRIPTION

Dimensions

Overall dimensions of the tested product	3000 x 3000 x 250 mm (height x width x thickness)
Modules dimensions	2900 x 850 x 250 mm (height x width x thickness)
	2900 x 450 x 250 mm (height x width x thickness)

Construction of the module

The double front frame construction of each module consists of studs and transoms made from C24 spruce profiles 45 x 95 mm. The top and bottom edges of the modules are covered with 12,0 mm thick plywood. Each stud is fixed to the plywood with two 8,0 x 100 mm TX40 washer head screws. The transoms at the top and bottom of the module edge are fixed to the plywood with 4,5 x 50 mm TX20 countersunk head screws 65 mm from the edges and at maximum 240 mm centres. The transoms within the module are positioned 970 mm from the top and bottom edges of the module and are fixed between the studs with two 4,5 x 50 mm TX20 countersunk head screws.

The opposing transoms within the module are joined together with two 150 mm wide by 12,0 mm thick plywood strips positioned 80 mm from the studs and fixed to the transoms with a 4,5 x 50 mm TX20 countersunk head screw. In the case of the 450 mm wide module, the transoms within the module are joined together with only one plywood strip positioned at the mid-width of the transoms.

The core of the module is compressed straw with a nominal bulk density of 115 kg.m⁻³.

Joining of the modules

The modules are fixed together along the vertical edges with 8,0 x 120 mm TX40 washer head screws positioned just above/below the top and bottom transoms and next at maximum 476 mm centres.

Two 100 x 100 mm C24 timber profiles are placed at the top of the wall along the front and rear edges and fixed to the modules with 8,0 x 120 mm TX40 washer head screws at maximum 400 mm centres.

Covering of the wall

Internal wall face is covered by wood fiber board type SteicoUnderfloor (manufacturer: STEICO UK Limited, Caddington, United Kingdom), bulk density 250 kg.m⁻³, thickness 7 mm. Boards are fixed to timber frame construction by steel staples 25 x 100 mm spaced each 70 mm at the perimeter of wall and each 150 mm at wall surface to vertical timber profiles of modules.

Wood fiber board external surface is covered by Internal clay plaster type Classic Clay Plaster (manufacturer: Mr. Clay, Alytus, Lithuania), 25 mm thick with jute reinforcement mesh (120 g.m⁻²), mas per surface area 1500 g.m⁻².



3. TEST REPORTS IN SUPPORT OF CLASSIFICATION

3.1 TEST REPORTS

No.	Name of laboratory	Name of sponsor	Test report No.	Date of the test	Test method	Type of the test
[1]	FIRES, s.r.o., Batizovce, SR	EcoCocon UAB, Kybartai, Lithuania	FIRES-RF-036-25-AUNE	11. 07. 2025	EN 13823: 2020 + A1: 2022	A
[2]			FIRES-RF-038-25-AUNE	08. 08. 2025 03. 09. 2025	EN ISO 11925-2: 2020	A
[3]			FIRES-RF-040-25-AUNE	03. 09. 2025	EN ISO 11925-2: 2020	A

Type of the test: A – accredited, N – non-accredited

[1] – [3] Test specimens were conditioned according to EN 13823 before the reaction to fire

- [1] Test of Loadbearing wall composed of EcoCocon straw modules with internal face covering
- [2] Test of Loadbearing wall composed of EcoCocon straw modules with internal face covering excluding core. Specimens were exposed with flame to main surface of clay layer, to bottom edge of clay layer, to the bottom edge of the wood fibre board, in the middle of the board thickness (specimen turned 90°), to main surface of spruce profile and to bottom edge of spruce profile.
- [3] Test of Compressed straw of EcoCocon straw modules. Specimens were exposed with flame to main surface and to bottom edge of the specimens.

3.2 TEST SPECIMENS

Test report No.	Samples information	Conditioning
[1]	-	The specimen was stored in the hall of testing laboratory and conditioned according to EN 13238 under following climatic conditions: Ambient air temperature: 22,4 °C, st. deviation 0,5 °C Relative air humidity: 45,6 %, st. deviation 6,5 %
[2]	-	The specimen was stored in the hall of testing laboratory and conditioned according to EN 13238 under following climatic conditions: 08. 08. 2025 Ambient air temperature: 23,3 °C, st. deviation 2,3 °C Relative air humidity: 45,3 %, st. deviation 5,6 % 03. 09. 2025 Ambient air temperature: 23,1 °C, st. deviation 0,5 °C Relative air humidity: 46,5 %, st. deviation 4,8 %
[3]	-	The specimen was stored in the hall of testing laboratory and conditioned according to EN 13238 under following climatic conditions: Ambient air temperature: 23,1 °C, st. deviation 0,7 °C Relative air humidity: 46,5 %, st. deviation 4,8 %



3.3 TEST RESULTS

Test report number and test method	Characteristic value	Number of tests	Results	
			Continuous parameter - mean (m)	Compliance with parameters
[1] STN EN 13823	FIGRA _{0,2MJ}	3	0,0	(-)
	FIGRA _{0,4MJ}		0,0	(-)
	LFS<edge of specimen		(-)	compliant
	THR _{600s}		0,3	(-)
	SMOGRA (m ² /s ²)		0,0	(-)
	TSP600s (m ²)		2,1	(-)
	flaming droplets/particles		occurrence flaming ≤ 10 s flaming >10 s	non-compliant (-) (-)
[2] EN ISO 11925-2 surface/edge of specimen exposed to flame (exposure time 30 s)	F _s ≤ 150 mm	30	(-)	compliant
flaming droplets/particles	ignition of the paper		(-)	non-compliant

4. CLASSIFICATION AND FIELD OF APPLICATION

4.1 REFERENCE OF CLASSIFICATION

This classification has been carried out in accordance with clause 11.6 of EN 13501-1: 2018.

4.2 CLASSIFICATION

The product, Loadbearing wall composed of EcoCocon straw modules, in relation to its reaction to fire behaviour is classified:

B

The additional classification in relation to smoke production is:

s1

The additional classification in relation to flaming droplets/particles is:

d0

The format of the reaction to fire classification for construction products excluding floorings is:

Fire behaviour		Smoke production			Flaming droplets	
B	-	s	1	,	d	0

Reaction to fire classification: B – s1, d0




4.3 FIELD OF APPLICATION

This classification is valid for the following final use applications:

- i) external walls (classification valid from interior side);
- ii) partitions (classification valid from interior side);
- iii) characteristic product orientation: vertical;
- iv) edges: protected/closed edges.

This classification is also valid for the following product parameters:

Composition	The classification applies to the products described in the quantities used (clause 2.2), and all products and components which have: <ul style="list-style-type: none"> - the same or lower content of organic materials; - the same or higher content of flame retardants of the same; - the same or lower PCS value of used materials. The order of the individual layers must not be changed.
Bulk density/mass per surface of area	<ul style="list-style-type: none"> - bulk density/mass per surface of area of clay plaster, straw, wood and plywood can be increased only; - change in bulk density/mass per surface of area of wood fibre board is not allowed; - bulk density/mass per surface of area of reinforcing mesh can be reduced only.
Thickness	<ul style="list-style-type: none"> - change in thickness of straw is allowed without limitations; - thickness of reinforcing mesh, wood and wood-based materials (plywood, wood fibre board) can be reduced only; - thickness of clay plaster can be increased only.
Surfaces/finishing	Surfaces/finishing with reaction to fire class A1, or A2 can be used only.

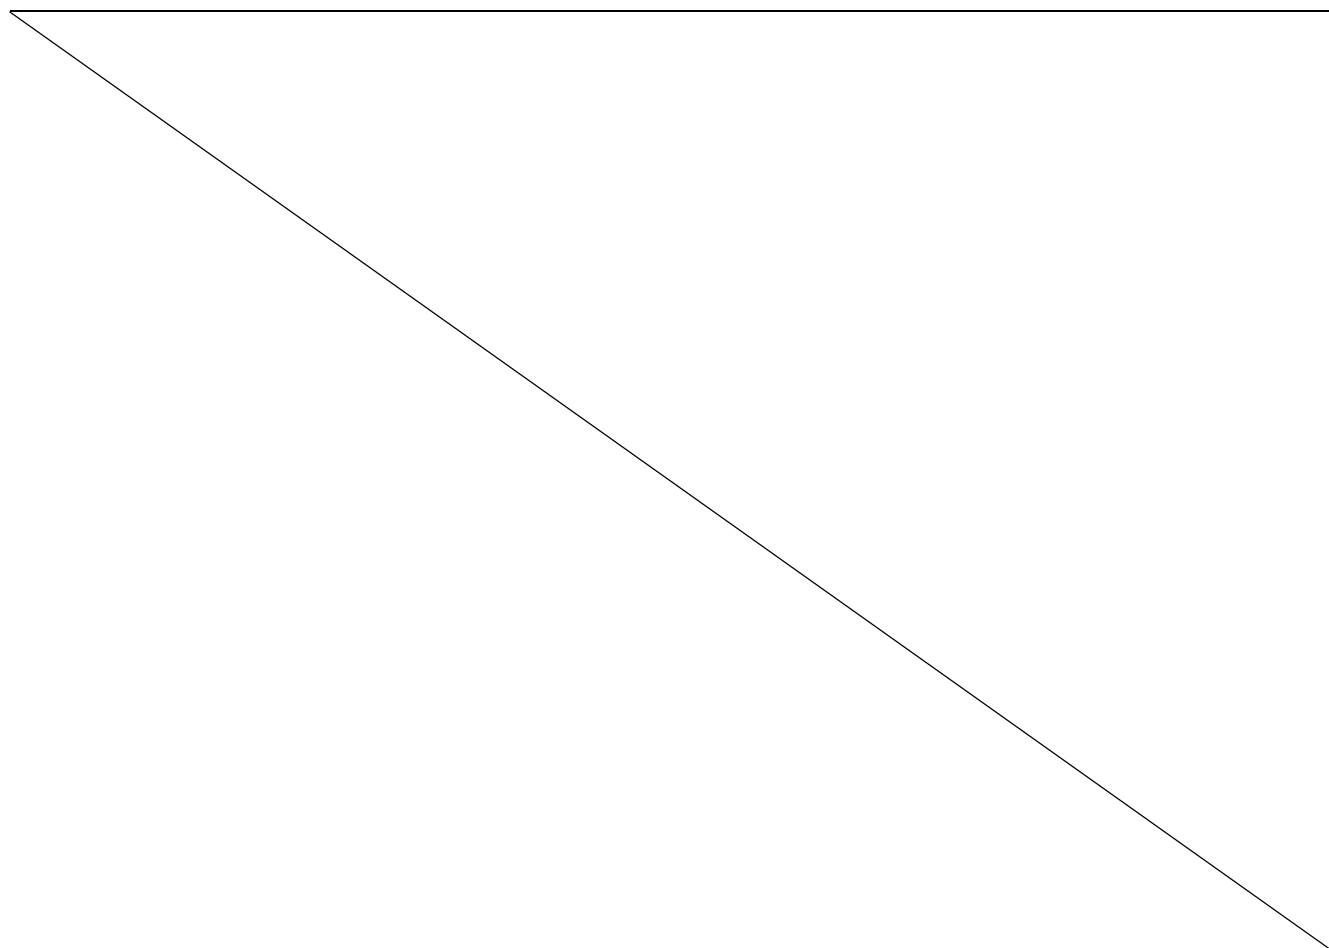



5. LIMITATIONS

This classification document does not represent type approval or certification of the product.

The classification is valid provided that the product, field of application and standards and regulations are not changed.

Approved by:

Ing. Marek Gorlický
Head of the Testing Laboratory

Prepared by:

Ing. Samuel Skokan
Technician of the Testing Laboratory

